


The BELL INN MORETONHAMPSHEAD Ground floor.

N

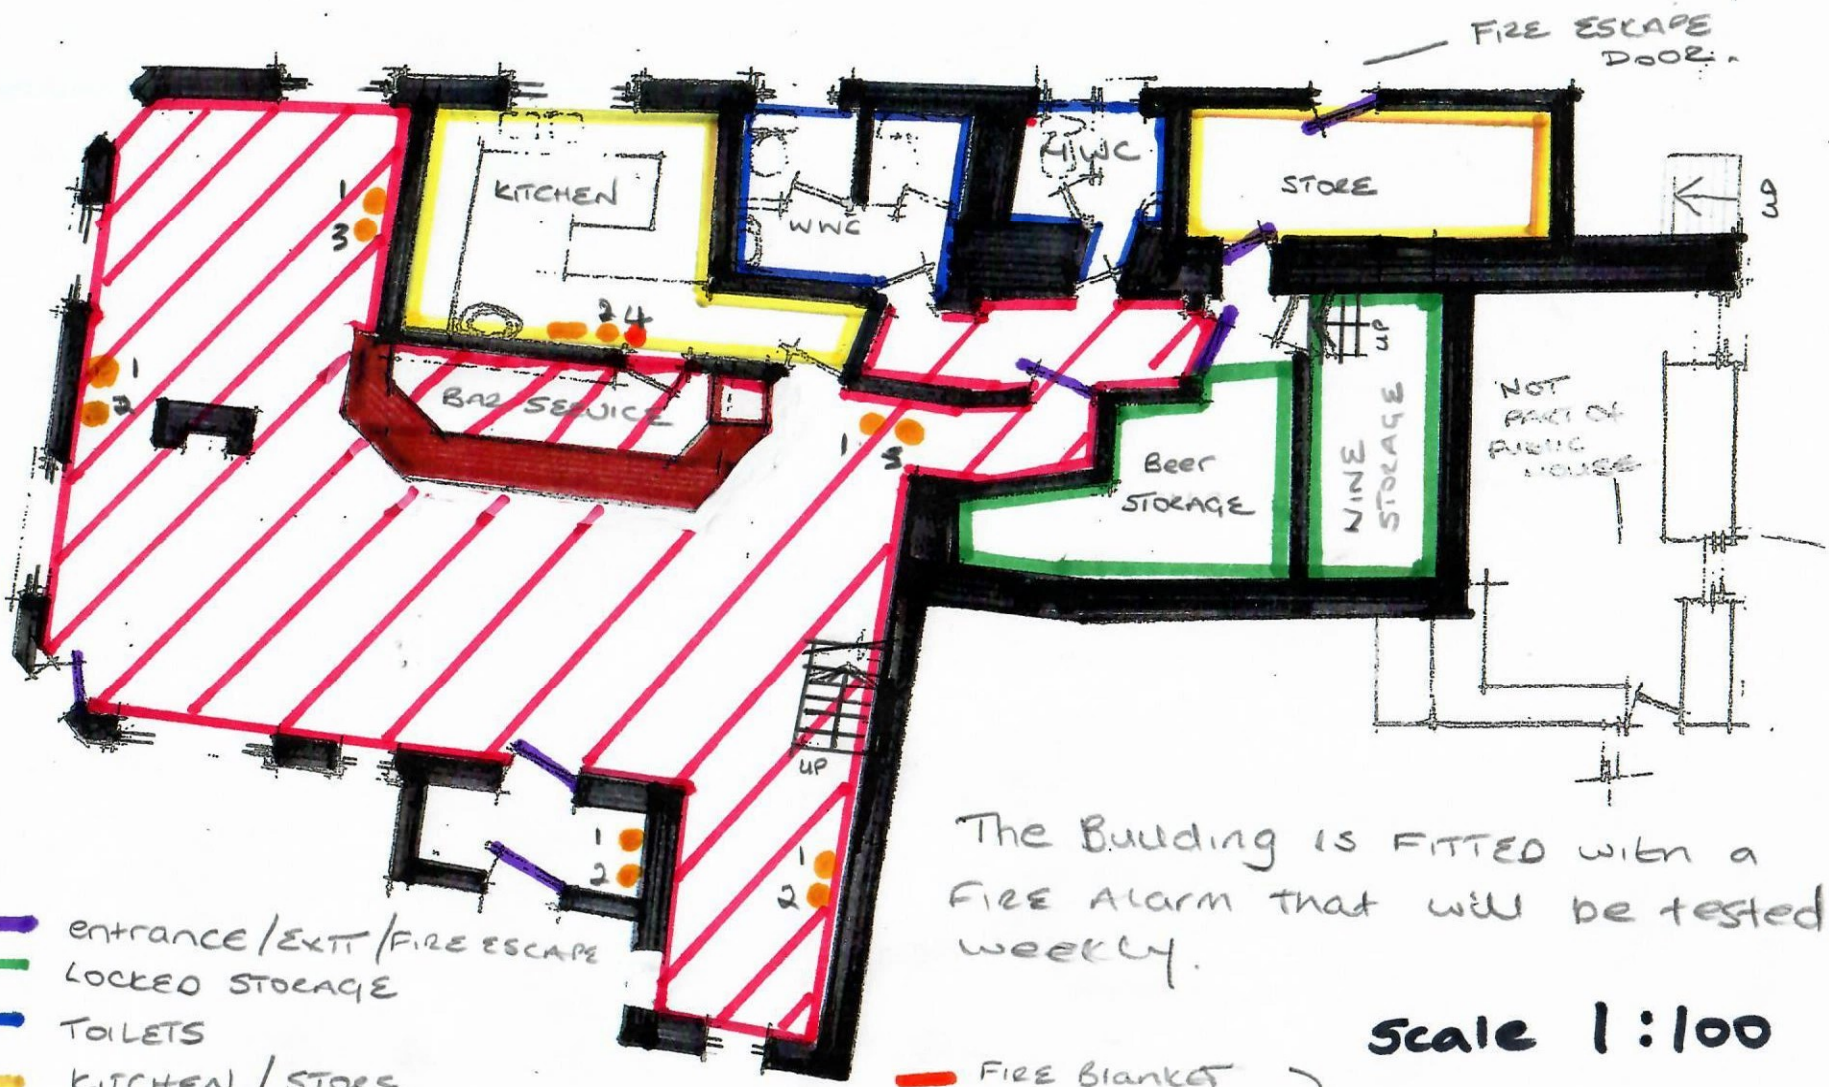

- ENTRANCE/EXIT/FIRE ESCAPE
- LOCKED STORAGE
- TOILETS
- KITCHEN / STORE
- LICENSED TRADING AREA
- FIRE EXTINGUISHERS / BLANKETS

- FIRE BLANKET
- 1 CO2
- 2 DRY POWDER
- 3 FOAM
- 4 WET CHEMICAL
- 5 WATER

The Building is FITTED with a FIRE ALARM that will be tested WEEKLY.

Scale 1:100

Service to BS 5306-3